

Summary Compliance Report for Quarter				Quarter 4		
WGN970255[2656]	Parameter	Limit	Metric	April 2025	May 2025	June 2025
Purpose for Which Right is Granted	Discharge Flows	Discharge flows may not exceed 18,600 m3/day into Mazengarb Stream.	No. days discharge flows exceeded limit.	0	0	0
Condition 18 (a) (i)	BOD5	The Geometric Mean for BOD from 12 monthly samples must be under 15g/m3	Geometric mean	5.40	4.13	2.38
		Only one BOD sample/month may exceed 25g/m3	No. days sample exceeded limit.	0	0	0
Condition 18 (a) (ii)	Suspended Solids	The Geometric Mean for Suspended Solids from 12 monthly samples must be under 15g/m3	Geometric mean	6.64	3.81	2.75
		Only one Suspended Solids sample/month may exceed 25g/m3	No. days sample exceeded limit.	0	0	0
Condition 18 (b) (i)	Faecal Coliform Bacteria	The Geometric Mean for Faecal Coliform from 12 monthly samples must be under 200 MPN	Geometric mean	9	6	5
		Only one sample/month may exceed 5000MPN/100ml	No. days sample exceeded limit.	0	0	0
Condition 18 (b) (ii)	pH	Based on 12 samples/month, the pH must stay within 6-9 (shows the geo mean)	Geometric mean	7.3	7.4	6.4
Condition 18 (c)	Ammonia	Based on 36 consecutive samples, no more than 3 of 36 Ammonia samples exceed 3.6 g/m3.	Geometric mean	0.07		
Condition 18 (c)	Nitrates	Based on 36 consecutive samples, no Nitrate sample may exceed 30 g/m3.	Geometric mean	7.4		
Condition 18 (c)	Dissolved Phosphorus	No limit - requirement only to analyse samples.	Confirms samples analysed	Y	Y	Y
Condition 18 (c)	Total Phosphorus	No limit - requirement only to analyse samples.	Confirms samples analysed	Y	Y	Y
Condition 18 (e)	Dissolved Metals	No limit - requirement only to analyse samples.	Confirms samples analysed	Y	Y	Y
Condition 18 (d)	Dissolved Oxygen	Based on 36 consecutive samples, no more than 3 Dissolved Oxygen samples may be below 5 ppm.	Geometric mean	6.72		
WGN970255 [34837]	Parameter	Limit		Compliant?	Compliant?	Compliant?
Purpose for Which Right is Granted	Stormbasin use	Permitted to use three times/year	No. times used	0	0	1
Condition 7 (b)	Notify GWRC	Required to notify GWRC when used.	No. times notified.	0	0	0
WGN030149 [22566]	Parameter	Limit		Compliant?	Compliant?	Compliant?
Purpose for Which Right is Granted	Discharge screened, diluted wastewater as overflow from the stormbasin	No limit - In general accordance with consent documents.	No. times used	0	0	0
Condition 2	Notify GWRC	Required to notify GWRC when used.	No. times notified	0	0	0
WGN040098	Parameter	Limit		Compliant?	Compliant?	Compliant?
Purpose for Which Right is Granted	Discharge contaminants to land from decommissioned sludge lagoons	No limit - In general accordance with consent documents.	Confirms compliance.	Y	Y	Y
WGN130218 [32196]	Parameter	Limit		Compliant?	Compliant?	Compliant?
Purpose for Which Right is Granted	Discharge contaminants to air from Wastewater Treatment Plant Operation and Maintenance	No limit - In general accordance with consent documents.	Confirms compliance.	Y	Y	Y
Condition 5	Boiler Temperature	Must be maintained above 650 degrees (when recorded temperature is increased by 20% taking into account probe location, excludes maintenance & repair)	No. times temperature dropped below 650 degrees	0	0	0
Condition 13	Monitor and record plant parameters	Requirement to continuously monitor and record plant parameters and report to GWRC annually.	Confirms compliance.	Y	Y	Y
Condition 17 & 18	Complaints and incidents.	Requirement to record/report complaints and incidents.	No. complaints/incidents.	0	0	0

Paraparaumu WWTP - 24h Composite Sampling of Effluent

	Parameter	Alkalinity	BOD	COD	Total N	TSS
	Units	g/m³	g/m³	g/m³	g/m³	g/m³
Limit 1 (Geometric Mean)		15				15
Limit 2 (must not exceed for >1/12)		25				25
Year-To-Date Summary						
Number of Samples		28	28	28	28	28
Geometric Mean						
YTD		66.33	4.16	23	8.45	4.47
Apr-25		149.63	5.40	36.74	13.19	6.64
May-25		45.72	4.13	19.65	6.97	3.81
Jun-25		27.05	2.38	10.95	5.03	2.75
Jul-25						
Maximum		75	10	45	10	9.5
No. Samples > limit 1		0	0	0	0	0
No. Samples > limit 2			0			0

Sample Date	Sample Location	Alkalinity	BOD	COD	Total N	TSS
		g/m³	g/m³	g/m³	g/m³	g/m³
3/04/2025	24h Comp	72	2.9	26	10	7.6
4/04/2025	24h Comp	68.5	4.5	21	9.2	4.3
9/04/2025	24h Comp	68.5	5.1	22	8.2	9.5
10/04/2025	24h Comp	69	2.4	22	8.9	3.9
12/04/2025	24h Comp	64	2.3	24	9.7	2.7
14/04/2025	24h Comp	70	5.7	21	8.8	8.9
16/04/2025	24h Comp	72	5.9	16	7.4	6.2
23/04/2025	24h Comp	67	4.5	18	9.4	3.9
25/04/2025	24h Comp	60.5	3.5	21	9.6	3.6
28/04/2025	24h Comp	73	5.3	24	7.4	3.9
29/04/2025	24h Comp	73	4.4	27	9	4.3
1/05/2025	24h Comp	69.1	5.7	21	8.7	6.9
2/05/2025	24h Comp	75	4.4	15	9.5	3.8
5/05/2025	24h Comp	64.1	4.4	29	8	3.9
7/05/2025	24h Comp	64.6	3.3	14	9.4	2.3
11/05/2025	24h Comp	61.8	4.4	20	8.6	4.2
13/05/2025	24h Comp	64.5	5.1	20	7	6
15/05/2025	24h Comp	63.1	5.1	31	9.1	6.6
17/05/2025	24h Comp	62.3	4.5	29	8.2	5
19/05/2025	24h Comp	69	5.4	33	7.9	6.6
23/05/2025	24h Comp	64.5	10	31	8.8	4.5
26/05/2025	24h Comp	63.8	4.2	29	7.8	3.1
29/05/2025	24h Comp	63.1	5.8	45	9.4	3
2/06/2025	24h Comp	71.8	2.5	17	7.7	4.6
5/06/2025	24h Comp	60.6	3.7	25	7.7	2.7
7/06/2025	24h Comp	58	2.4	21	8.6	2.2
10/06/2025	24h Comp	66.3	3.3	20	8	4.9
12/06/2025	24h Comp	62.1	2.6	15	6.1	5.4

Year-to-Date Trends

Paraparaumu WWTP - Post UV Grab Sampling

Parameter	Faecal Coliforms (Out)	Temperature at Time of Sampling	DO (Following Cascade)	pH	Flow Rate	UV Dose Rate
Units	cfu/100 mL	°C	g/m³	0	L/s	mJ/cm²
Limit 1	200		5	6		
Limit 2	5000			9		
Year-To-Date Summary						
Number of Samples	91	91	91	91	91	91
Geometric Mean	7	19.3	6.72	7.33	160.73	63.88
Apr-25	9	21.2	6.4	7.3	153.4	63.7
May-25	6	19.2	6.9	7.4	161.7	66.1
Jun-25	5	14.4	6.0	6.4	119.6	47.1
Maximum (Min for DO)	35	22.3	5.61	8.85	209	104.9
No. Samples > limit 1	0	0	0	0	0	0
No. Samples > limit 2	0					

Sample Date	Sample Location	Faecal Coliforms (Out)	Temperature at Time of Sampling	DO (Following Cascade)	pH	Flow Rate	UV Dose Rate
		cfu/100 mL	°C	g/m³	0	L/s	mJ/cm²
1/04/2025	Post UV Grab	20	22.2	6.79	7.3	149	60.2
2/04/2025	Post UV Grab	12	22.3	6.62	7.25	159	56.6
3/04/2025	Post UV Grab	12	22.1	6.16	7.24	151	58
4/04/2025	Post UV Grab	16	17.8	6.59	7.26	170	102.4
5/04/2025	Post UV Grab	6	21.6	6.56	6.76	162	62.5
6/04/2025	Post UV Grab	11	21.8	6.51	6.95	176	59.1
7/04/2025	Post UV Grab	9	21.9	6.44	7.37	163	60
8/04/2025	Post UV Grab	22	21.5	6.69	7.02	169	61.2
9/04/2025	Post UV Grab	12	21.2	7.13	7.16	163	61
10/04/2025	Post UV Grab	32	21.4	6.74	7.22	161	59.1
11/04/2025	Post UV Grab	11	21.4	5.86	7.19	162	61.3
12/04/2025	Post UV Grab	13	21.4	6.35	7.24	150	56.3
13/04/2025	Post UV Grab	10	21.5	6.72	7.17	151	62.1
14/04/2025	Post UV Grab	35	21.5	6.26	7.42	154	60.3
15/04/2025	Post UV Grab	29	21.3	6.22	7.13	135	58.5
16/04/2025	Post UV Grab	10	21.1	6.08	7.89	169	104.9
17/04/2025	Post UV Grab	17	21	6.24	7.1	143	58.1
18/04/2025	Post UV Grab	14	21.6	6.16	7.59	144	60.6
19/04/2025	Post UV Grab	14	21.9	6.4	7.09	135	62.7
20/04/2025	Post UV Grab	6	21.9	6.12	7.13	138	62.9
21/04/2025	Post UV Grab	7	22	5.98	7.26	158	59.2
22/04/2025	Post UV Grab	2	21.3	6.81	7.59	171	103.4
23/04/2025	Post UV Grab	2	21.1	7.45	7.22	154	59.5
24/04/2025	Post UV Grab	3	21.7	6.29	7.66	149	57.7
25/04/2025	Post UV Grab	5	20.6	6.96	7.09	139	67
26/04/2025	Post UV Grab	4	20.6	6.22	7.8	145	61
27/04/2025	Post UV Grab	2	20.9	6.24	7.19	128	60.4
28/04/2025	Post UV Grab	7	21	6.21	7.54	148	60.1
29/04/2025	Post UV Grab	6	21.4	6.42	7.21	153	60.2
30/04/2025	Post UV Grab	6	21.3	6.48	7.6	150	59.5
1/05/2025	Post UV Grab	7	20.4	6.94	7.15	160	61.1
2/05/2025	Post UV Grab	12	19.2	6.39	7.74	166	60
3/05/2025	Post UV Grab	6	19.4	6.92	7.25	184	57.8
4/05/2025	Post UV Grab	9	19.5	7.58	7.6	160	61.6
5/05/2025	Post UV Grab	3	19.4	6.56	7.28	169	59.8
6/05/2025	Post UV Grab	11	19.3	6.73	8.2	160	59.8
7/05/2025	Post UV Grab	2	19.5	6.78	7.24	152	61.6
8/05/2025	Post UV Grab	3	19.6	6.3	8.05	166	92
9/05/2025	Post UV Grab	8	19.8	6.74	7.26	161	60.9
10/05/2025	Post UV Grab	7	19.5	6.89	7.27	172	58.1
11/05/2025	Post UV Grab	14	19.5	6.89	7.23	159	61.2
12/05/2025	Post UV Grab	9	19.5	7.74	6.8	167	58.8
13/05/2025	Post UV Grab	5	19.5	6.83	7.05	152	59.1
14/05/2025	Post UV Grab	4	19.5	6.49	7.82	154	60.7
15/05/2025	Post UV Grab	5	19.4	7.58	7.18	146	60.4
16/05/2025	Post UV Grab	6	19.5	7.07	8.43	157	59.3
17/05/2025	Post UV Grab	1	20	7.27	7.19	149	60.7
18/05/2025	Post UV Grab	7	19.7	6.49	7.27	141	57.2
19/05/2025	Post UV Grab	6	18.8	7.3	7.66	181	60.2
20/05/2025	Post UV Grab	5	18.1	6.47	7.48	172	92.9
21/05/2025	Post UV Grab	0.5	18.5	6.48	7.21	167	85.6
22/05/2025	Post UV Grab	8	18.9	6.89	6.7	209	72.2
23/05/2025	Post UV Grab	5	19	7.44	7.22	173	80.8
24/05/2025	Post UV Grab	8	18.8	6.99	7.27	169	85.5
25/05/2025	Post UV Grab	10	18.7	6.56	7.54	164	58.9
26/05/2025	Post UV Grab	12	18.8	6.85	7.35	154	59.1
27/05/2025	Post UV Grab	6	19.3	6.45	6.88	162.8	102.9
28/05/2025	Post UV Grab	6	19	6.74	7.54	158	61.1
29/05/2025	Post UV Grab	8	19	6.31	7.58	156	60.5
30/05/2025	Post UV Grab	21	18.9	6.86	7.29	162	57.2
31/05/2025	Post UV Grab	10	18.7	6.81	7.32	170	57.4
1/06/2025	Post UV Grab	3	18.7	6.34	7.02	111	67.7
2/06/2025	Post UV Grab	4	18.9	7.47	7.55	179	94.4
3/06/2025	Post UV Grab	11	18.8	6.95	7.232	148	59.3
4/06/2025	Post UV Grab	3	18.8	6.07	7.97	170	91.5
5/06/2025	Post UV Grab	22	18.5	6.51	7.29	168	60.6
6/06/2025	Post UV Grab	7	18.5	7.18	8.85	168	81.2
7/06/2025	Post UV Grab	2	18.1	6.31	7.23	170	86.2
8/06/2025	Post UV Grab	10	17.4	6.41	8.02	141	62
9/06/2025	Post UV Grab	2	17.6	5.61	7.33	178	76.3
10/06/2025	Post UV Grab	3	17.4	7.02	6.78	157	85.5
11/06/2025	Post UV Grab	2	17.7	7.67	7.22	161	91.2
12/06/2025	Post UV Grab	3	17.2	6.71	7.84	204	66.9
13/06/2025	Post UV Grab	2	17.3	5.99	7.38	193	56.9
14/06/2025	Post UV Grab	2	17.1	6.78	7.25	184	50.5
15/06/2025	Post UV Grab	15	17	7.28	7.42	184	50.9
16/06/2025	Post UV Grab	13	16.5	7.23	6.72	171	54.8
17/06/2025	Post UV Grab	9	16.5	6.89	7.33	169	50.3
18/06/2025	Post UV Grab	8	16.8	6.89	6.69	165	52.7
19/06/2025	Post UV Grab	13	17.3	6.91	7.31	159	53.2
20/06/2025	Post UV Grab	5	17.2	6.32	7.2	177	53.3
21/06/2025	Post UV Grab	11	17	6.57	7.26	165	52.3
22/06/2025	Post UV Grab	7	17	6.63	7.29	159	59.1
23/06/2025	Post UV Grab	18	17	9.08	7.35	169	54.1
24/06/2025	Post UV Grab	5	16.8	6.8	7.35	151	60.8
25/06/2025	Post UV Grab	7	16.9	7.32	7.33	170.4	56.9
26/06/2025	Post UV Grab	5	17.1	6.84	7.26	156	63.9
27/06/2025	Post UV Grab	6	17.5	6.59	7.14	160	64.3
28/06/2025	Post UV Grab	6	17.4	7.3	7.27	185	59.8
29/06/2025	Post UV Grab	5	17.3	7.39	7.3	173	58.3
30/06/2025	Post UV Grab	5	17.4	7.83	6.95	174	56.1

Year-to-Date Trends

Paraparaumu WWTP - Flow Channel Grab Sampling

Parameter	Temperature at Time of Sampling	TSS	Total Ammonia-N	Nitrate-N	Nitrite-N	DRP	Total P
Units	°C	g/m³	g/m³	g/m³	g/m³	g/m³	g/m³
Limit 1 (Geometric Mean)			3.6	30			
Limit 2 (must not exceed for >1/12)							
Year-To-Date Summary							
Number of Samples	45	45	45	45	45	45	36
Geometric Mean	16.97	5.57	0.05	5.99	0.01	0.03	0.26
Apr-25	17.90	6.69	0.04	6.53	0.01	0.03	0.34
May-25	14.75	5.18	0.06	5.08	0.01	0.03	0.39
Jun-25	15.22	4.46	0.04	5.73	0.01	0.04	0.32
Maximum	21.9	15.6	0.07	7.4	0.017	0.40	0.58
No. Samples > limit 1	0	0	0	0	0	0	0
No. Samples > limit 2							


Sample Date	Sample Location	Temperature at Time of Sampling	TSS	Total Ammonia-N	Nitrate-N	Nitrite-N	DRP	Total P
		°C	g/m³	g/m³	g/m³	g/m³	g/m³	g/m³
1/04/2025	Flow Channel Grab	19.1	5.6	0.042	6.42	0.015	0.025	0.23
4/04/2025	Flow Channel Grab	19.4	8.9	0.04	7.34	0.0075	0.025	0.368
5/04/2025	Flow Channel Grab	21.9	4.8	0.048	5.86	0.0075	0.025	0.227
9/04/2025	Flow Channel Grab	17.4	6.9	0.039	6.48	0.017	0.025	
10/04/2025	Flow Channel Grab	15.9	5.1	0.034	6.51	0.015	0.025	0.219
11/04/2025	Flow Channel Grab	16.5	6.9	0.032	6.66	0.0075	0.025	0.244
13/04/2025	Flow Channel Grab	13.8	7.3	0.063	7.2	0.015	0.025	0.297
15/04/2025	Flow Channel Grab	19.6	15.6	0.032	5.76	0.0075	0.053	0.432
17/04/2025	Flow Channel Grab	19.2	6	0.05	6.28	0.0075	0.025	0.252
19/04/2025	Flow Channel Grab	21.9	10.2	0.054	6.87	0.0075	0.025	
24/04/2025	Flow Channel Grab	13.2	5.4	0.049	6.86	0.0075	0.025	0.249
26/04/2025	Flow Channel Grab	15.1	6.5	0.056	7.4	0.0075	0.025	0.225
28/04/2025	Flow Channel Grab	17.6	6.3	0.048	6.51	0.0075	0.025	
29/04/2025	Flow Channel Grab	19.2	5.3	0.042	6.36	0.0075	0.025	0.227
30/04/2025	Flow Channel Grab	20.7	5.3	0.051	6.33	0.0075	0.025	0.256
2/05/2025	Flow Channel Grab	20.1	5.3	0.05	5.83	0.0075	0.025	0.244
3/05/2025	Flow Channel Grab	20.9	3.8	0.059	6.68	0.0075	0.025	0.216
6/05/2025	Flow Channel Grab	18.9	6.8	0.049	5.27	0.0075	0.025	0.308
8/05/2025	Flow Channel Grab	15.5	5.5	0.054	6.42	0.0075	0.025	0.268
11/05/2025	Flow Channel Grab	16.7	5.6	0.065	5.6	0.0075	0.025	
12/05/2025	Flow Channel Grab	16.3	4.7	0.047	4.69	0.0075	0.025	0.224
14/05/2025	Flow Channel Grab	18.9	6	0.05	5.16	0.0075	0.025	0.271
16/05/2025	Flow Channel Grab	19.7	8.2	0.055	5.82	0.0075	0.025	0.316
18/05/2025	Flow Channel Grab	19.7	6.5	0.06	5.11	0.0075	0.025	0.296
20/05/2025	Flow Channel Grab	19.7	7	0.043	5.18	0.0075	0.025	0.28
23/05/2025	Flow Channel Grab	17.3	5.3	0.054	5.96	0.0075	0.025	
24/05/2025	Flow Channel Grab	18.4	7.7	0.063	5.89	0.0075	0.025	0.25
27/05/2025	Flow Channel Grab	16.9	6.4	0.044	6.47	0.017	0.025	0.265
30/05/2025	Flow Channel Grab	15.2	4.7	0.058	6.05	0.0075	0.025	0.332
31/05/2025	Flow Channel Grab	17.2	5	0.043	6	0.0075	0.025	
3/06/2025	Flow Channel Grab	18.8	4	0.029	6.41	0.015	0.025	0.174
6/06/2025	Flow Channel Grab	14.1	4.8	0.044	5.6	0.0075	0.025	0.187
8/06/2025	Flow Channel Grab	12.3	3.4	0.052	6.07	0.0075	0.025	0.2
9/06/2025	Flow Channel Grab	15.5	4.3	0.041	6.32	0.0075	0.025	
11/06/2025	Flow Channel Grab	17.9	2.1	0.043	5.95	0.0075	0.025	0.216
13/06/2025	Flow Channel Grab	17.8	4.9	0.036	4.71	0.0075	0.025	0.208
15/06/2025	Flow Channel Grab	17.2	6.7	0.024	5.12	0.0075	0.025	
18/06/2025	Flow Channel Grab	15.8	6	0.059	4.32	0.0075	0.025	0.24
19/06/2025	Flow Channel Grab	12	5.1	0.049	6.19	0.0075	0.025	0.252
22/06/2025	Flow Channel Grab	11.6	3.2	0.065	6.69	0.0075	0.025	0.24
23/06/2025	Flow Channel Grab	11.4	5.1	0.042	6.48	0.0075	0.025	0.178
24/06/2025	Flow Channel Grab	14	6	0.045	5.21	0.0075	0.025	0.208
27/06/2025	Flow Channel Grab	17.2	4.8	0.07	6.23	0.0075	0.397	
28/06/2025	Flow Channel Grab	18.1	4.7	0.052	5.74	0.016	0.354	0.578
30/06/2025	Flow Channel Grab	18	4.2	0.04	5.59	0.0075	0.33	0.49

Year-to-Date Trends


Paraparaumu WWTP - Quarterly Flow Data **Apr-25** / **Jun-25**

Location	Influent Flow		Effluent Flow		Rainfall
	Average rate	Total	Average rate	Total	Total
Limit				18600	
Units	L/s	m ³ /day	L/s	m ³ /day	mm
1/04/2025	98	8438	108	9305	0.0
2/04/2025	99	8541	109	9378	0.0
3/04/2025	97	8353	108	9323	0.0
4/04/2025	95	8178	108	9361	0.0
5/04/2025	140	12112	142	12290	26.4
6/04/2025	114	9883	134	11538	1.4
7/04/2025	117	10136	124	10724	1.7
8/04/2025	109	9405	118	10161	3.7
9/04/2025	110	9506	119	10309	4.1
10/04/2025	108	9322	115	9909	0.9
11/04/2025	106	9116	115	9946	0.0
12/04/2025	104	8966	115	9910	0.8
13/04/2025	106	9137	115	9898	0.0
14/04/2025	108	9320	116	10035	0.0
15/04/2025	100	8610	111	9587	0.0
16/04/2025	99	8544	109	9452	0.0
17/04/2025	107	9206	114	9873	0.0
18/04/2025	97	8391	110	9482	0.1
19/04/2025	109	9407	120	10345	4.6
20/04/2025	103	8870	116	10004	0.0
21/04/2025	108	9331	117	10108	2.1
22/04/2025	121	10467	128	11044	10.1
23/04/2025	108	9293	119	10265	0.3
24/04/2025	108	9371	115	9973	0.0
25/04/2025	105	9044	112	9698	0.0
26/04/2025	105	9085	113	9789	0.0
27/04/2025	105	9096	114	9850	0.0
28/04/2025	110	9484	118	10169	0.0
29/04/2025	98	8490	110	9464	0.0
30/04/2025	100	8672	111	9585	0.0
1/05/2025	102	8842	113	9738	2.9
2/05/2025	106	9159	116	9999	8.3
3/05/2025	102	8817	114	9848	1.5
4/05/2025	113	9765	120	10379	0.0
5/05/2025	108	9370	118	10234	0.0
6/05/2025	104	9019	116	10002	0.0
7/05/2025	101	8752	116	9981	0.3
8/05/2025	97	8370	113	9756	0.5
9/05/2025	103	8929	116	10024	0.2
10/05/2025	122	10505	133	11479	11.9
11/05/2025	117	10100	123	10626	0.0
12/05/2025	112	9697	119	10320	0.0
13/05/2025	104	8995	114	9845	0.0
14/05/2025	102	8837	113	9735	0.0
15/05/2025	102	8801	112	9696	0.0
16/05/2025	99	8591	110	9535	0.0
17/05/2025	101	8685	113	9739	0.0
18/05/2025	104	9004	114	9860	0.0
19/05/2025	173	14982	153	13221	24.5
20/05/2025	148	12789	148	12774	0.5
21/05/2025	118	10160	122	10574	0.0
22/05/2025	116	10024	122	10519	0.0
23/05/2025	108	9289	116	10006	0.0
24/05/2025	110	9500	117	10126	0.0
25/05/2025	112	9712	119	10324	0.0
26/05/2025	111	9617	119	10267	0.0
27/05/2025	104	8963	113	9798	0.4
28/05/2025	108	9314	117	10071	0.0
29/05/2025	108	9356	118	10168	2.8
30/05/2025	112	9719	120	10343	2.1
31/05/2025	112	9690	119	10293	0.0
1/06/2025	110	9504	118	10194	0.0
2/06/2025	110	9498	117	10103	0.0
3/06/2025	112	9702	120	10369	0.0
4/06/2025	105	9033	113	9760	0.7


5/06/2025	145	12503	142	12308	12.6
6/06/2025	127	10951	133	11450	0.4
7/06/2025	117	10130	123	10619	0.6
8/06/2025	125	10770	129	11113	2.5
9/06/2025	124	10738	127	10964	0.0
10/06/2025	116	10024	122	10530	0.0
11/06/2025	109	9445	117	10083	0.0
12/06/2025	184	15866	169	14588	26.3
13/06/2025	157	13601	156	13443	7.9
14/06/2025	152	13153	149	12900	7.3
15/06/2025	147	12666	143	12318	0.0
16/06/2025	141	12221	141	12212	0.0
17/06/2025	126	10867	131	11290	0.0
18/06/2025	119	10302	126	10865	0.0
19/06/2025	115	9957	123	10666	0.0
20/06/2025	119	10321	126	10888	4.5
21/06/2025	120	10371	125	10828	0.0
22/06/2025	118	10192	124	10711	0.0
23/06/2025	120	10366	126	10882	0.0
24/06/2025	119	10321	124	10717	0.0
25/06/2025	110	9501	118	10219	0.0
26/06/2025	113	9736	120	10389	3.7
27/06/2025	112	9678	121	10431	2.0
28/06/2025	119	10311	126	10881	4.9
29/06/2025	132	11366	135	11686	5.6
30/06/2025	131	11276	133	11493	2.1

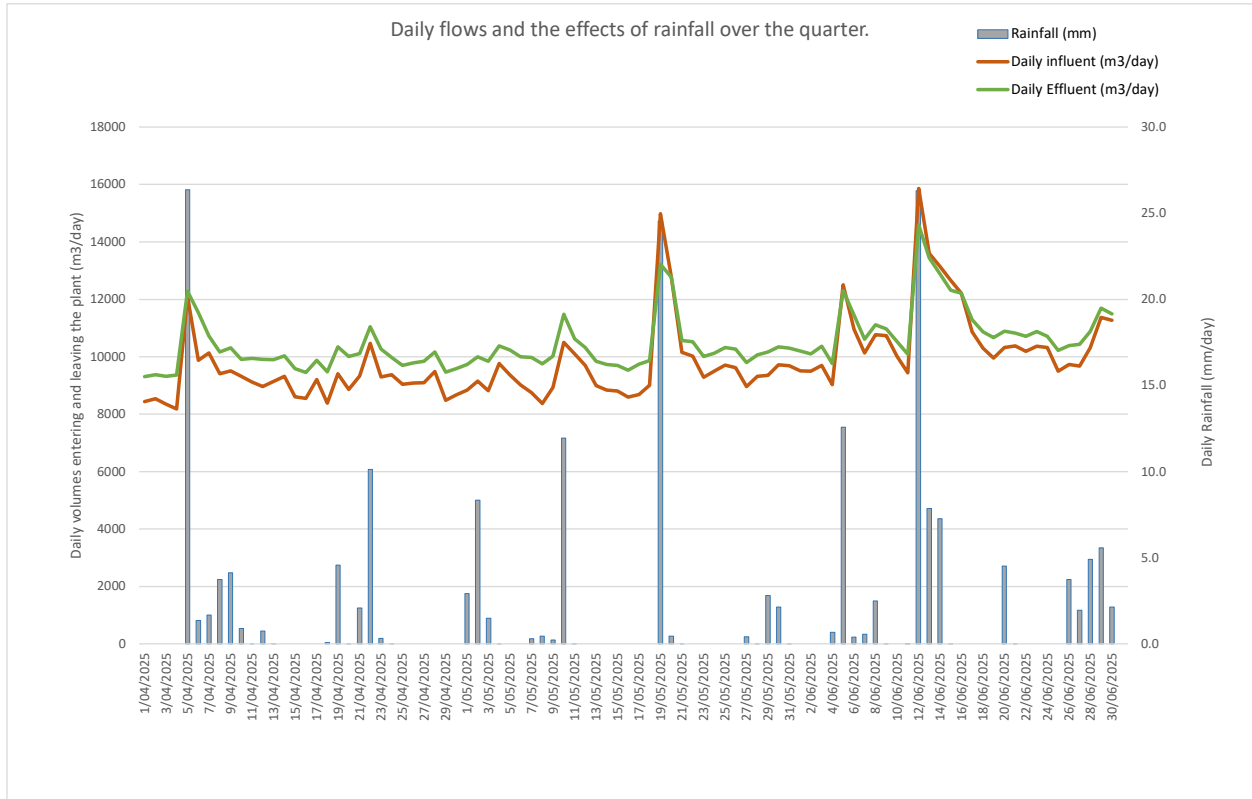


Quarterly compliance trending for the Paraparaumu WWTP effluent (Q4 2024/25)

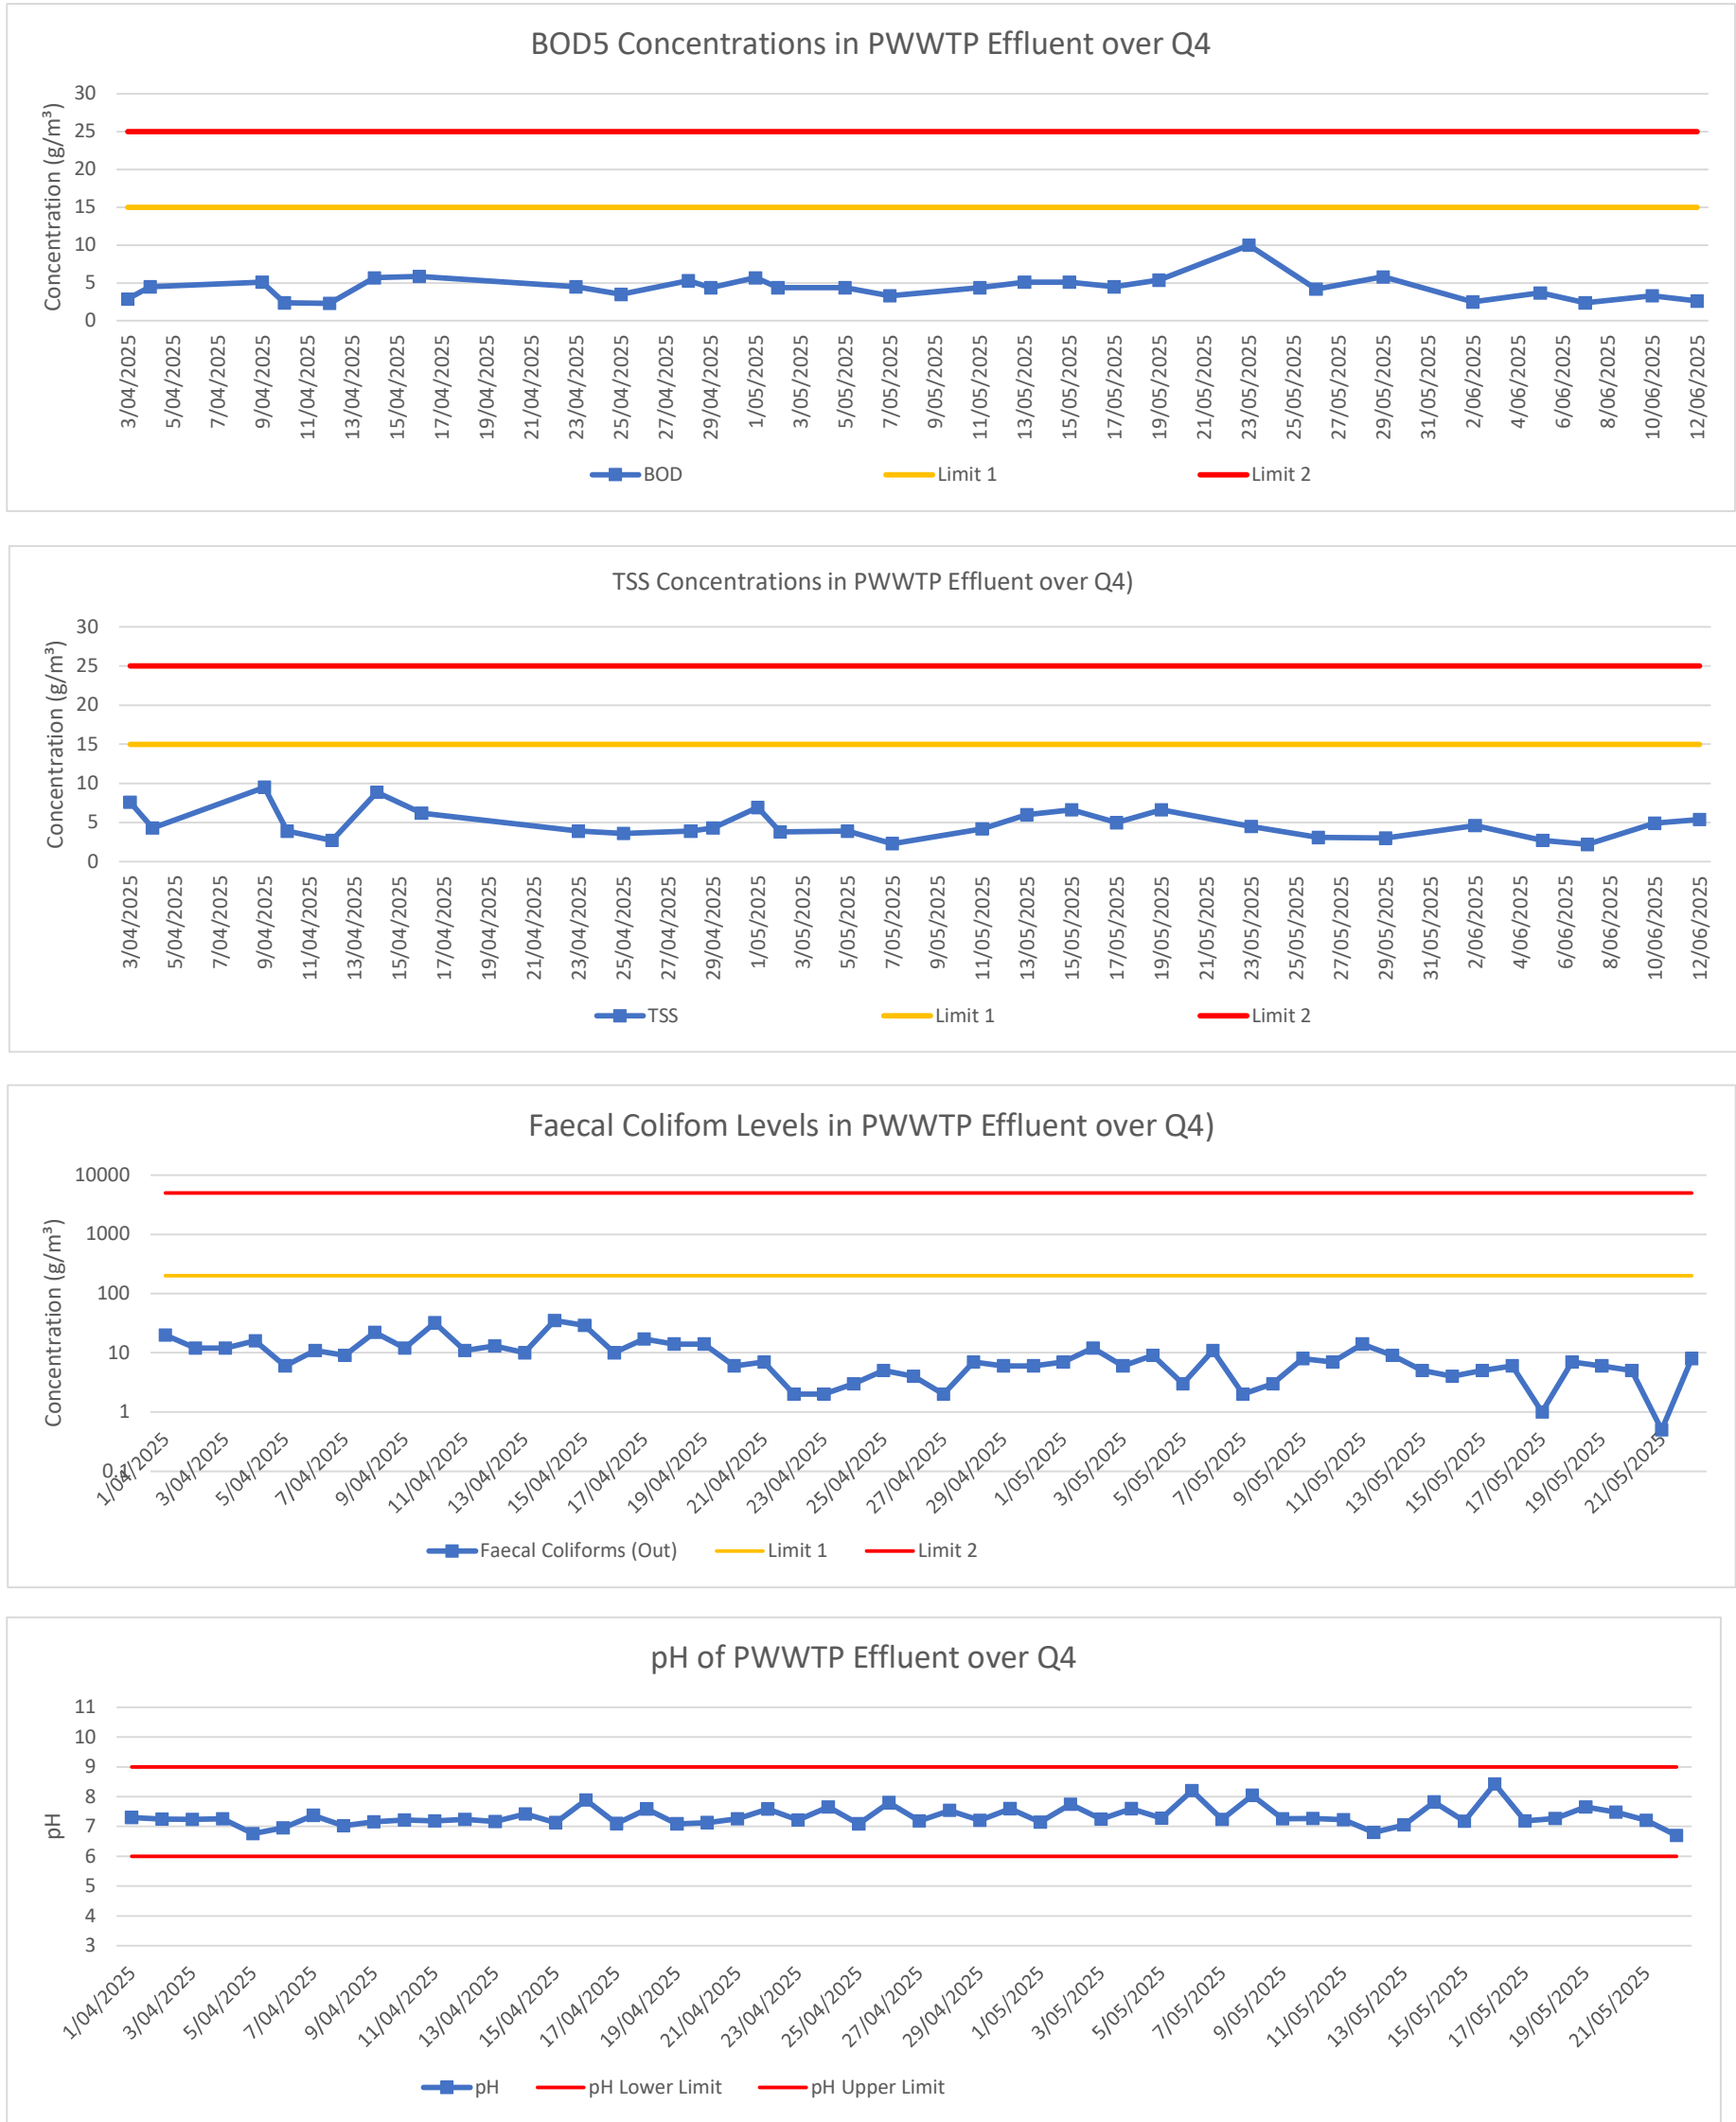

Nitrate Concentrations in PWWTP Effluent over Q4

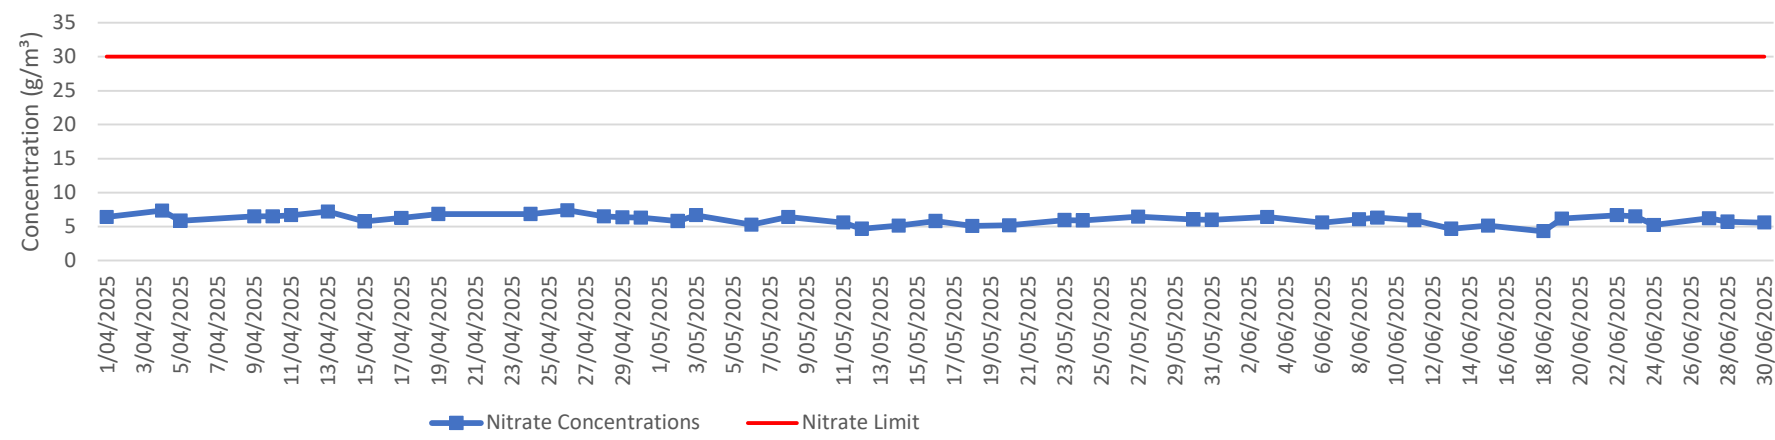

Ammoniacal Concentrations in PWWTP Effluent over Q4

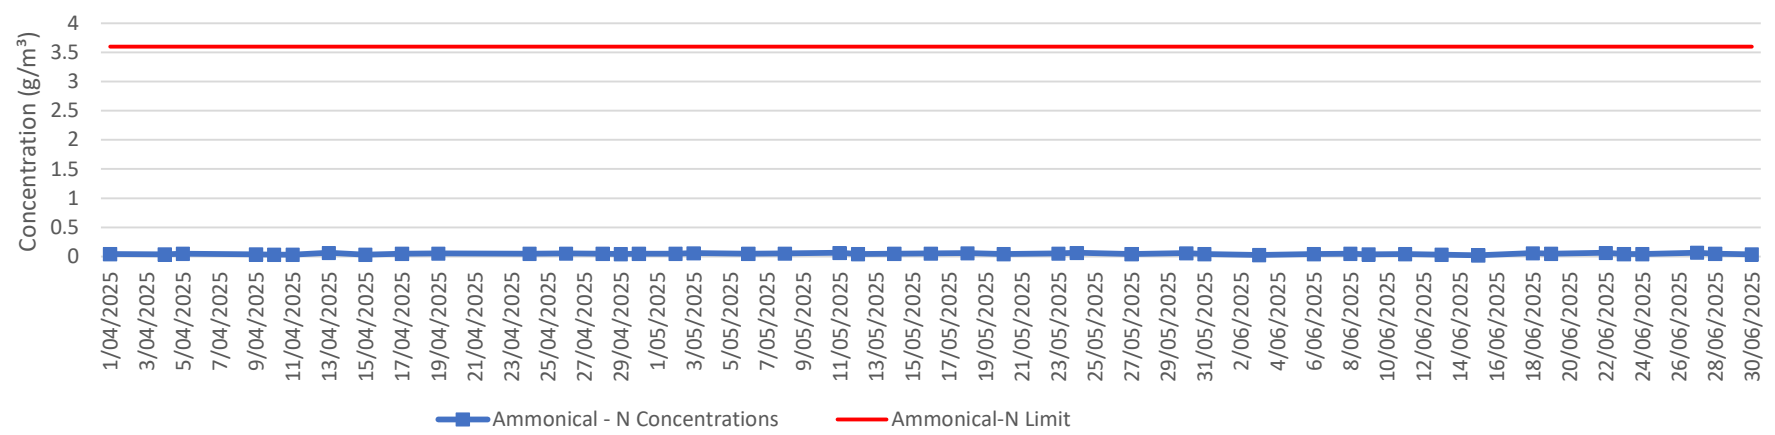

DO Concentrations in PWWTP Effluent over Q4

