


**PLAN OF VALVE CHAMBER LAYOUT**

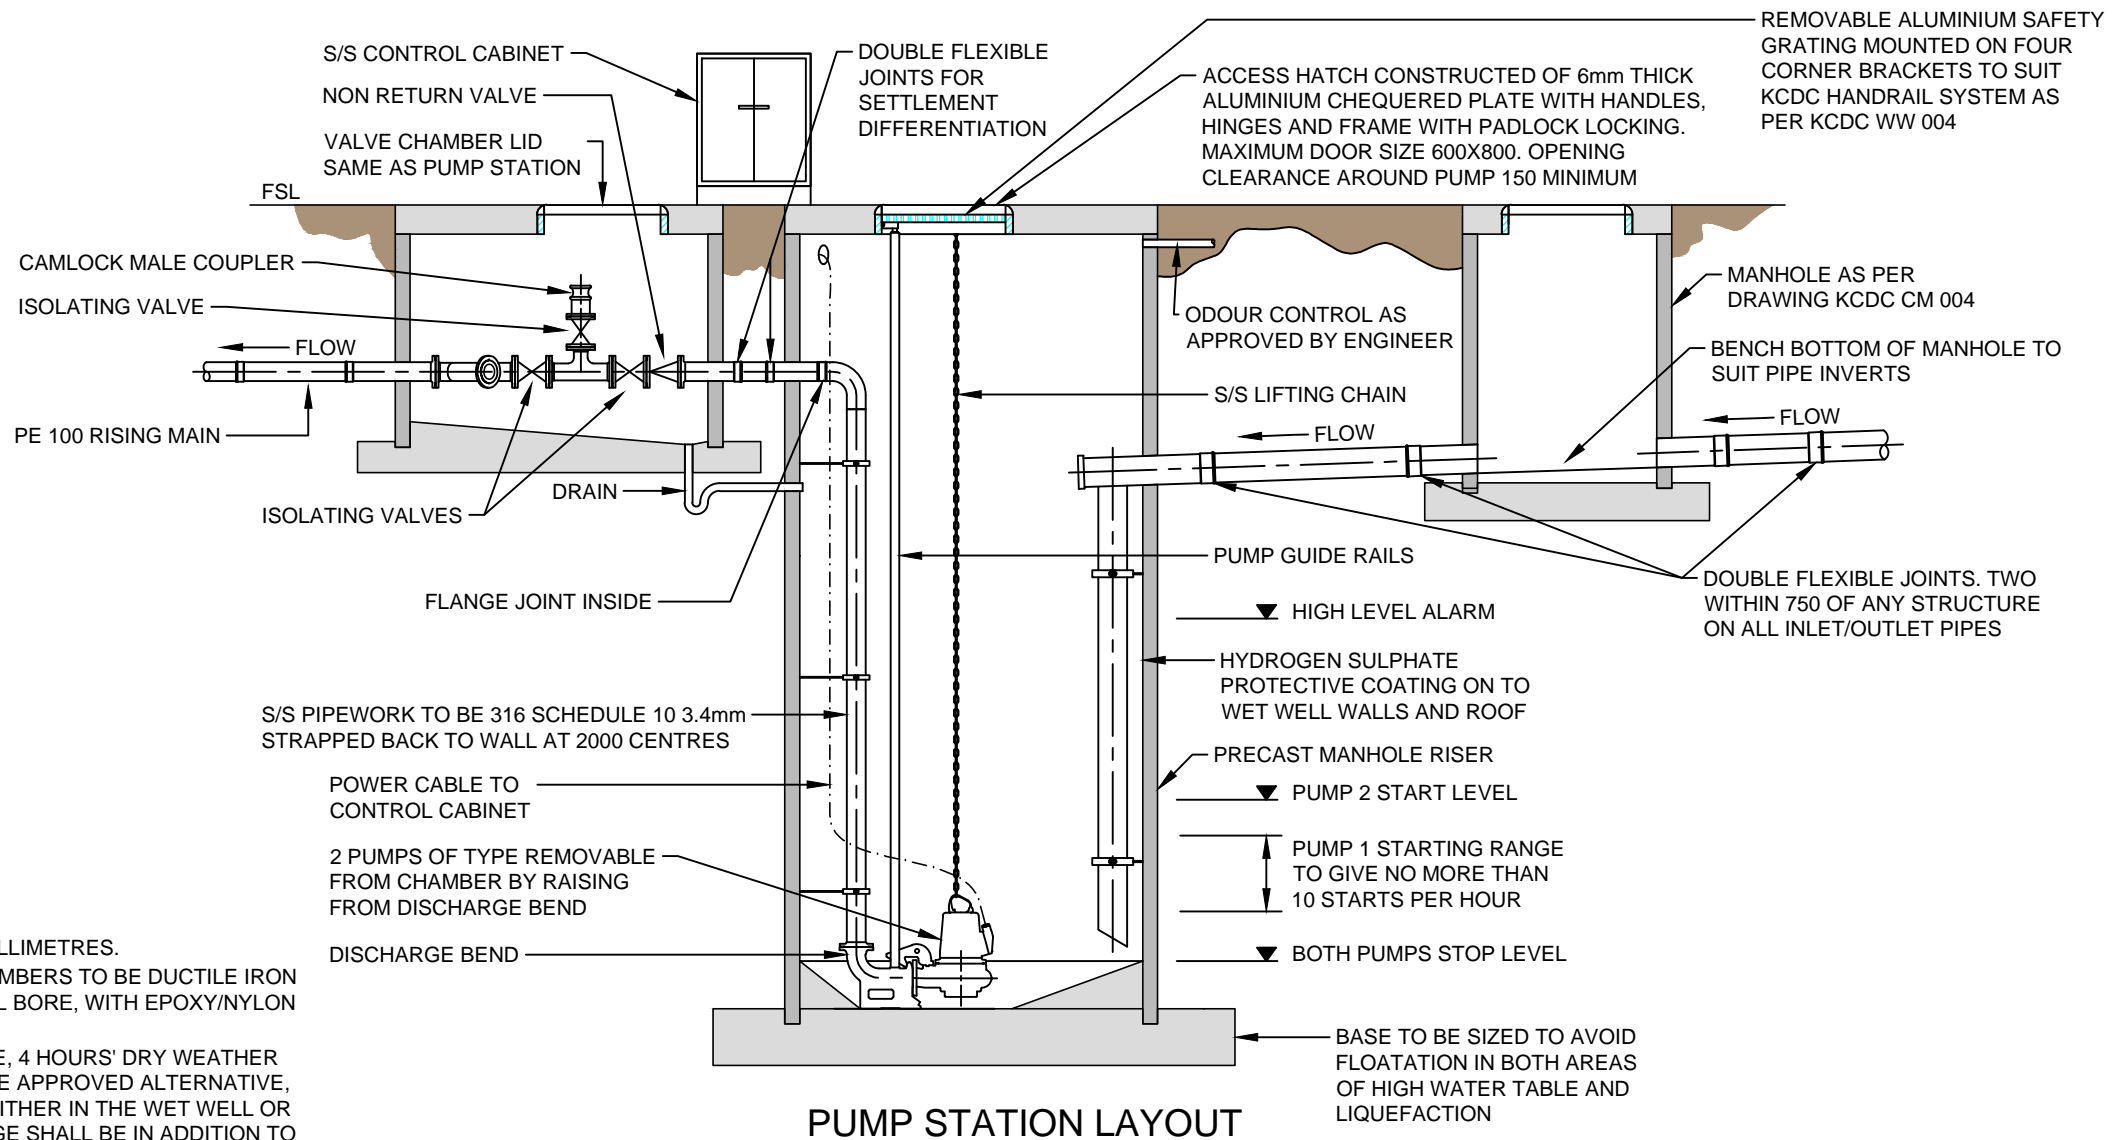

**PUMP STATION LAYOUT**

**NOTE:**

1. ALL DIMENSIONS IN MILLIMETRES.
2. ALL PIPEWORK IN CHAMBERS TO BE DUCTILE IRON OR ABS, 1000 NOMINAL BORE, WITH EPOXY/NYLON COATING.
3. EMERGENCY STORAGE, 4 HOURS' DRY WEATHER STORAGE OR SUITABLE APPROVED ALTERNATIVE, SHALL BE PROVIDED EITHER IN THE WET WELL OR OFFLINE. THIS STORAGE SHALL BE IN ADDITION TO THE OPERATIONAL WET WELL STORAGE.
4. CONTRACTOR TO APPLY FOR 20mm WASHDOWN WATER CONNECTION AND INSTALL RPZ BACKFLOW PREVENTION. REFER SHEET WS-012.
5. TO BE APPROVED BY COUNCIL ASSET ENGINEER.
6. PUMP INSTALLATION AS PER MANUFACTURERS SPECIFICATIONS.

150mm  
100  
50  
0  
10mm



**STANDARD DETAILS**  
**WASTEWATER PUMP STATION**  
**TYPICAL LAYOUT**

Drawn	Designed	
S. TURKINGTON	J. SAXTON	
Approved	Revision Date	
M. COLE	OCTOBER 2015	
Scale	Drawing No.	Revision
NOT TO SCALE	KCDC-WW-003	R2