



**TERMINAL MAINTENANCE SHAFT WITH PROPERTY CONNECTION AHEAD**  
ELEVATION

**TERMINAL MAINTENANCE SHAFT**  
ELEVATION

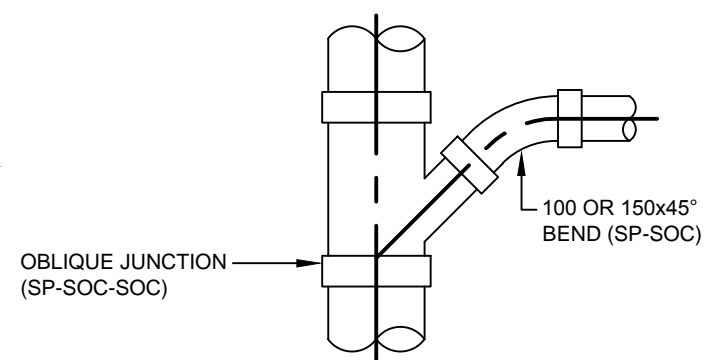

**TYPICAL PROPERTY CONNECTIONS**  
POSITIONED IN RISER AS SPECIFIED

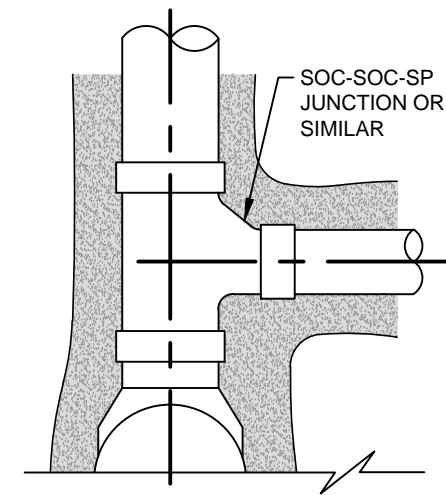

**DN 150 RETICULATION INLETS**  
POSITIONED IN RISER AS SPECIFIED

**NOTE:**

1. ALL DIMENSIONS IN MILLIMETRES.
2. ALL CONNECTION TYPES SHOWN ARE APPLICABLE TO PVC (RUBBER RING) PIPES UNLESS OTHERWISE SHOWN.
3. INSTALL BRANCH CONNECTIONS AND PROPERTY CONNECTIONS (AS SHOWN ABOVE) IN RISER SHAFT (DROP JUNCTIONS) WHERE SHOWN IN DESIGN DRAWINGS. MAXIMUM OF 1 RETICULATION INLET OR 2 PROPERTY CONNECTIONS.
4. ADJUST MS TO PIPE GRADE BY TILTING CHAMBER. MAX DEVIATION ADJUST MS TO PIPE GRADE BY TILTING CHAMBER. MAX DEVIATION FROM VERTICAL OF THE RISER TO BE 1:10 OR A MAXIMUM OF 300 AT SURFACE. USE KICKER BEND IF REQUIRED TO ADJUST RISER TO VERTICAL.
5. **ALL PUBLIC DRAINAGE TO BE AS/NZ1260 SN16**

© Copyright Standards New Zealand 2011. Drawings from NZS 4404:2010 have been reproduced with permission from Standards New Zealand under Copyright Licence 000904. Refer to the complete Standard available for purchase from Standards New Zealand.  
KCDC AMENDMENTS TO NZS 4404:2010 SHOWN IN **BOLD**.



**STANDARD DETAILS**  
**MAINTENANCE SHAFTS**  
**TMS & CONNECTION INSTALLATIONS**

Drawn	Designed	
S. TURKINGTON	J. SAXTON	
Approved	Revision Date	
M. COLE	OCTOBER 2015	
Scale	Drawing No.	Revision
NOT TO SCALE	KCDC-WW-006	R0